

HAMMOCKS AT CAPE HAZE

ARCHITECTURAL STANDARD

ENTRY DOORS

Entry Doors include Front, Rear and Garage entry doors.

1. All Entry Doors must meet the Florida and Charlotte County Building Code
2. THERMA TRU: "CLASSIC CRAFT" & "FIBER CLASSIC" Fiberglass Single- Door
Inswing/Outswing - "IMPACT" Doors, textured finish, are the APPROVED door. Specifications are attached.
See below for quick information.
3. Color of door is determined by the building type 'A', 'B', 'C' The building schedule and **SHERWIN WILLIAMS** color formulas are noted below.
4. In the event that the door frame must be replaced, the standard is included in the attached door specifications.
5. In the event that door hardware needs replacement, the standard door hardware specifications are attached -
Kwikset 660 Single Cylinder Deadbolt in Satin Nickel and Kwikset Lido Hall/Closet Lever in Satin Nickel.
The door knocker/viewer can be obtained, on line, from Harney hardware (harneyhardware.com).
6. Unit Owner must submit an Architectural Review Committee Request Form and have it approved prior to installing door
7. Upon completion of door installation, the unit owner must notify the Hammocks office manager and have the door installation inspected.

Door Information by Building Type and by Unit Entry Point				
Door Door Location	Door Description Model # Size			Sherwin Williams Color Formula
Villa Buildings				
"A" Building Addresses: 10600, 106001, 10620, 10640, 10641, 10641, 10700, 10720				See Sherwin Williams
Front Entry	Fiber Classic - Impact, Textured	FC60	3' x 6'8"	
Rear Entry	Fiber Classic - Impact, Textured	FC860	3' x 8'	
Garage Entry	Fiber Classic - Impact, Textured	FC860	3' x 8'	
Preserve Buildings				
"B" Building Addresses: 8500, 8520, 8540, 8560, 8581, 10520, 10540, 10550 START WITH EMERALD 6509-96671 DDP BASE, SEMI-GLOSS URETHANE TRIM ENAMEL				CCE*COLORANT OZ 32 64 128 B1 BLK 36 1 - G2 NEW GRN 21 1 1 NI RAW UMBER 18 1 1 Y3 DEEP GLD 3 - 1
Front Entry	Fiber Classic - Impact, Textured	FC860	3' x 8'	
"C" Building Addresses: 8541, 8561, 8571, 10501, 10521 START WITH EXTERIOR RESILIENCE GLOSS EXTRA WHITE				CCE*COLORANT OZ 32 64 128 B1 BLACK 6 2 2 G2 NEW GRN 10 - - Y3 DEEP GLD 11 - -
Front Entry	Fiber Classic - Impact, Textured	FC860	3' x 8'	

Note: If you are replacing the entire door system (door, frame, etc.) a permit is required by Florida Building Code. If you are replacing the door slab only, a permit is not required

Owner, Dennis Bryan, recently replaced his door and has these tips for other owners faced with the same issue:

- “1. The Therma Tru door comes with both sides pre primed.
2. Due to the nature of our harsh Florida environment I applied another coat of Kilz primer to each side. I then applied two coats of paint to each side of the door.
3. I purchased a rubber(?) door sweep and slid it on after the door was completely dry. No screws or glue needed. Home Depot or Lowes. Probably Wal-Mart as well.”

THERMA TRU®

THERMA TRU DOORS

118 INDUSTRIAL DR., EDGERTON, OH 43517

3'0" X 6'8"

"CLASSIC CRAFT"

FIBERGLASS SINGLE DOOR


INSWING / OUTSWING

"IMPACT"

GENERAL NOTES

1. This product has been evaluated and is in compliance with the 5th Edition (2014) Florida Building Code (FBC) structural requirements excluding the "High Velocity Hurricane Zone" (HVHZ).
2. Product anchors shall be as listed and spaced as shown on details. Anchor embedment to base material shall be beyond wall dressing or stucco.
3. When used in areas requiring wind borne debris protection this product complies with Section 1609.1.2 of the FBC and does not require an impact resistant covering. This product meets missile level "D" and excludes Wind Zone 4 as defined in ASTM E1996 and Section 1609.1.2.2 of the FBC.
4. For 2x stud framing construction, anchoring of these units shall be the same as that shown for 2x buck masonry construction.
5. Site conditions that deviate from the details of this drawing require further engineering analysis by a licensed engineer or registered architect.

TABLE OF CONTENTS	
SHEET #	DESCRIPTION
1	Typical elevations, design pressures & general notes
2	Door panel details
3	Horizontal cross sections
4	Vertical cross sections
5	Buck and frame anchoring - 2X buck masonry construction
6	Frame anchoring - 1X buck masonry construction
7	Bill of Materials & Components

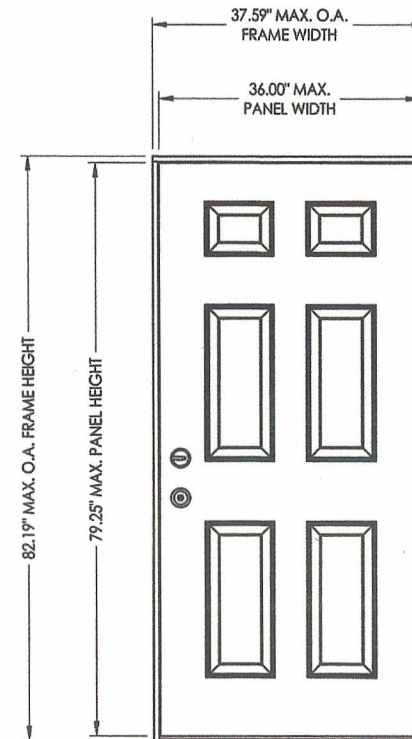

SWING	OVERALL FRAME DIMENSION	DESIGN PRESSURE (PSF)	
		POSITIVE	NEGATIVE
INSWING	37.59" x 82.19"	+67.0	-67.0
OUTSWING	37.59" x 80.69"	+67.0	-67.0

STATE OF FLORIDA
REGISTERED PROFESSIONAL ENGINEER
LYNDON F. SCHMIDT
 No. 43409

Documents Prepared By:
 Lyndon F. Schmidt
 P.E. No. 43409

BUILDING CONSULTANTS, INC.
 P.O. Box 230, Valrico, FL 33595
 Phone No.: 813.659.9197
 FBPE C.A. No. 9813


PRODUCT: THERMA-TRU FIBERGLASS DOOR

PART OR ASSEMBLY: TYPICAL ELEVATION, DESIGN PRESSURES & GENERAL NOTES

NO.	DATE	BY	REVISIONS
2	1/28/15	LFS	UPDATE TO 5TH ED. (2014) FBC
1	6/11/12	JK	REVISED TO 2010 FBC

DATE: 4/23/08
 SCALE: N.T.S.
 DWG. BY: AL
 CHK. BY: LFS
 DRAWING NO.: FL-5891.3
 SHEET 1 OF 7

© 2008 R.W. BUILDING CONSULTANTS INC.

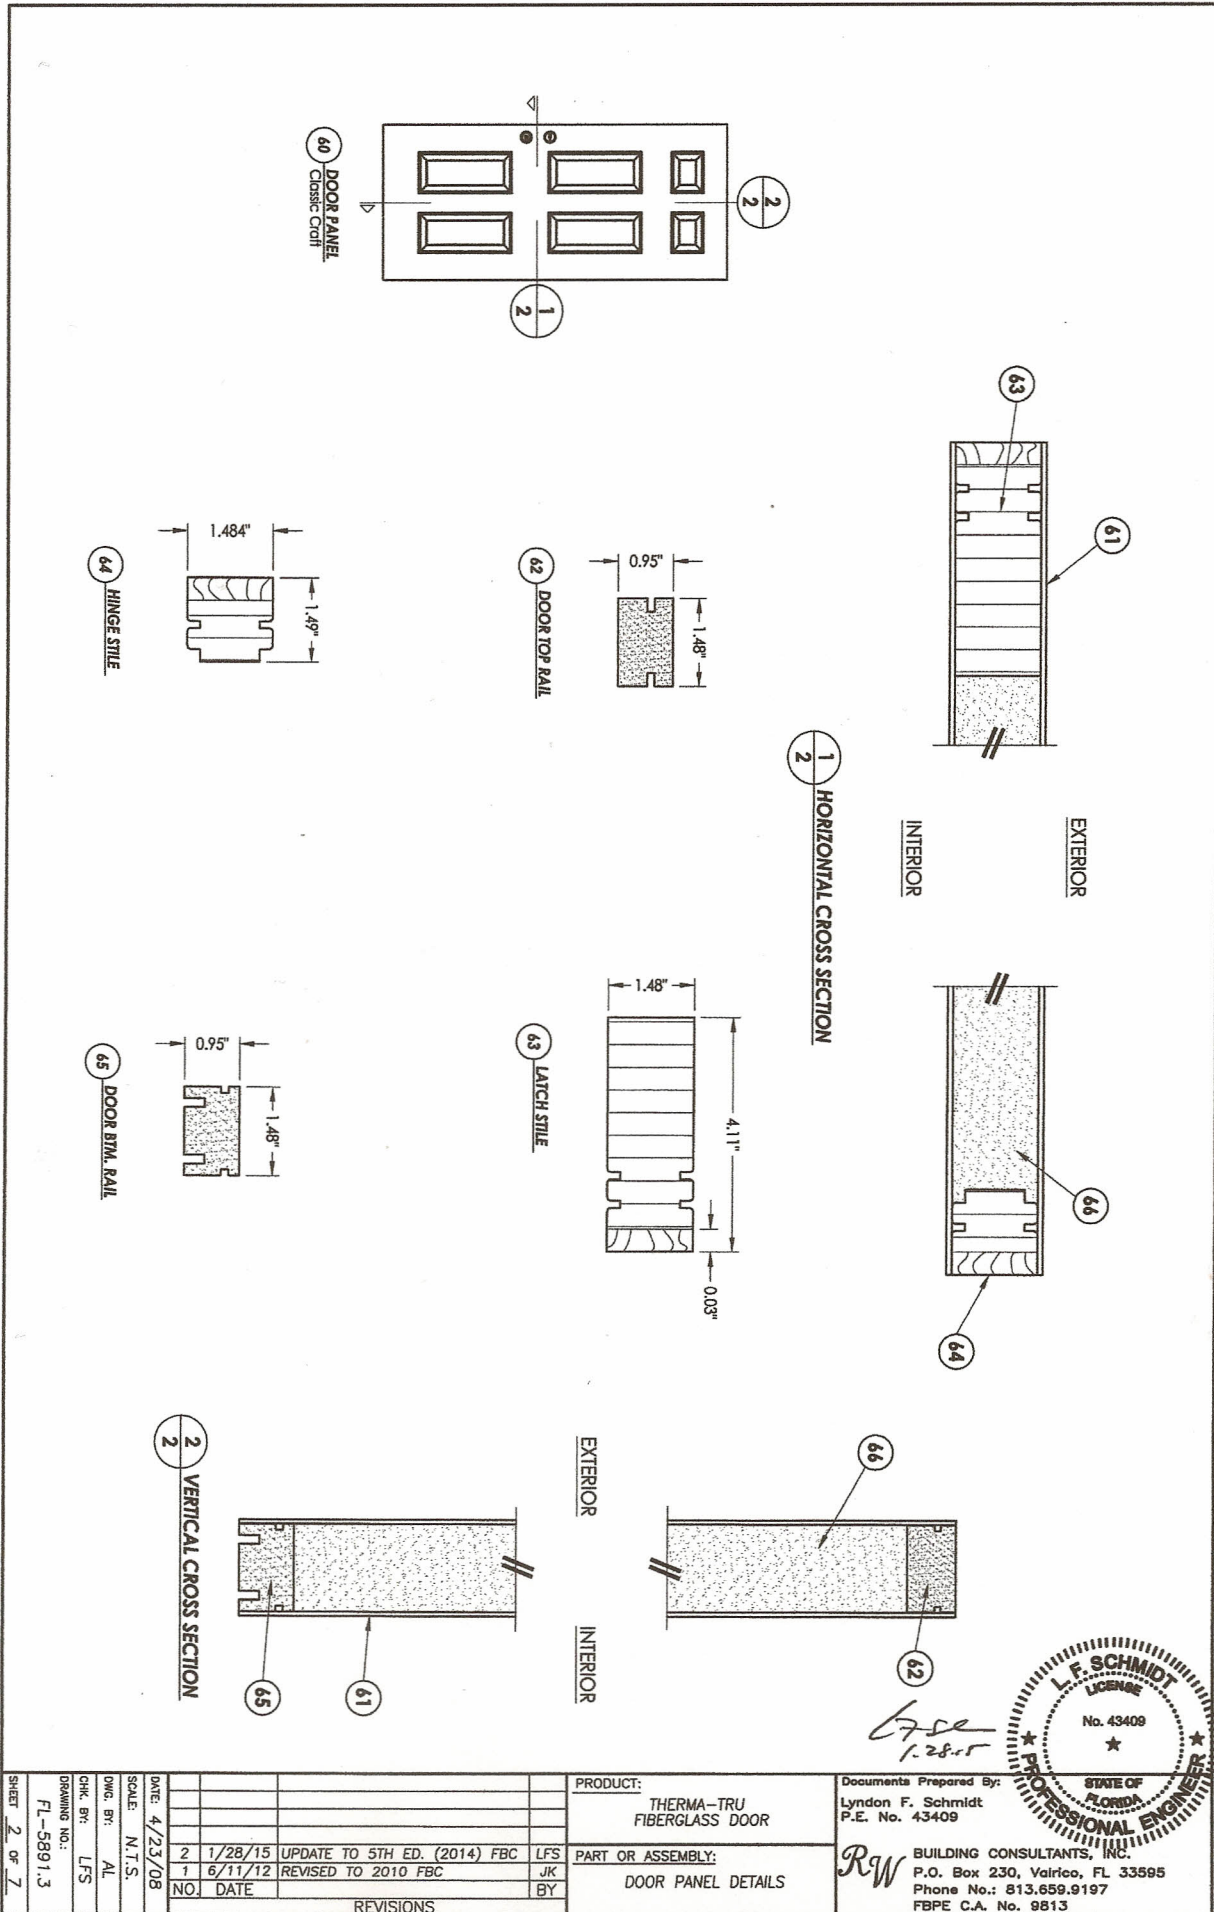





BUILDING CONSULTANTS, INC.
 P.O. Box 230, Vero Beach, FL 33595
 Phone No.: 813.659.9197
 FBP# C.A. No. 9813

P.E. No. 43409
 Lyndon F. Schmidt
 Documents Prepared By:


1.28.11
 [Signature]


L.F. SCHMIDT
 LICENSE
 No. 43409
 STATE OF
 FLORIDA
 PROFESSIONAL ENGINEER

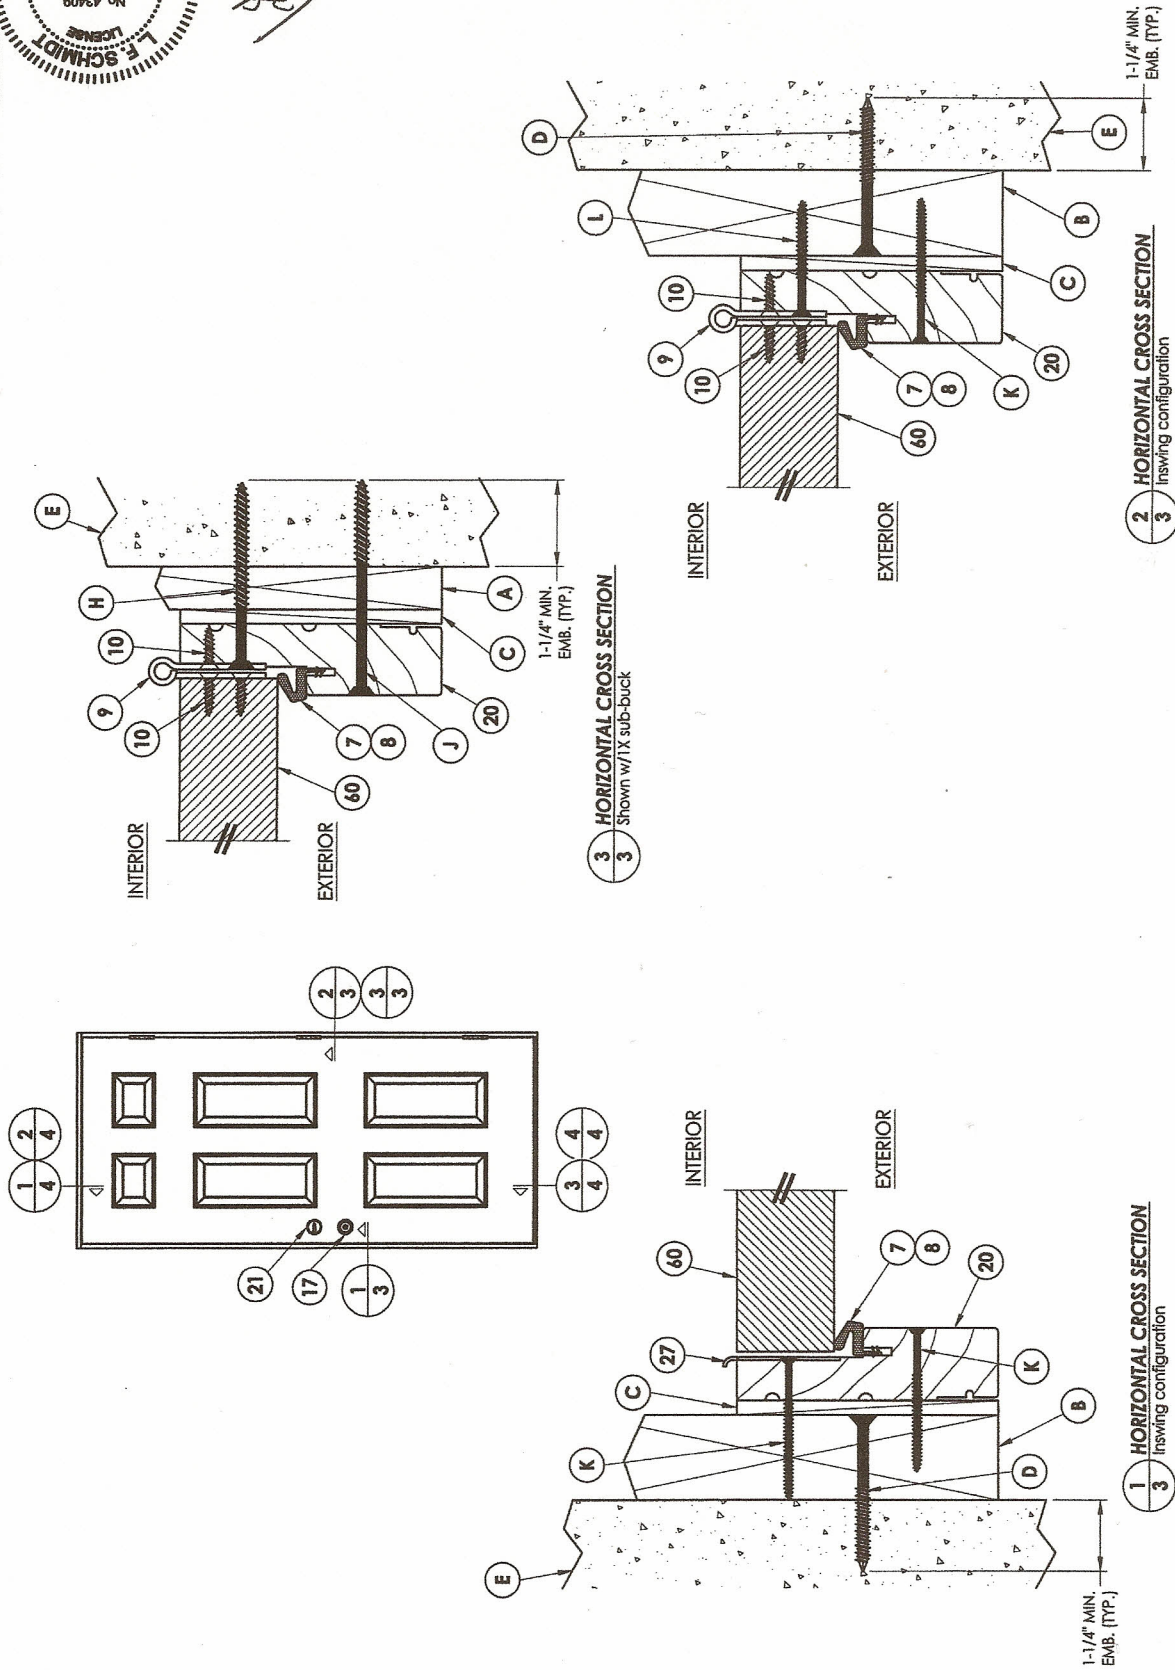

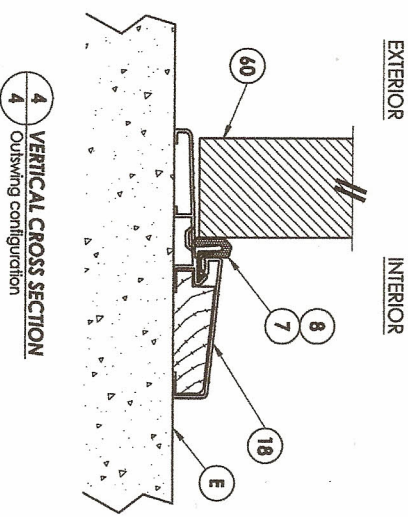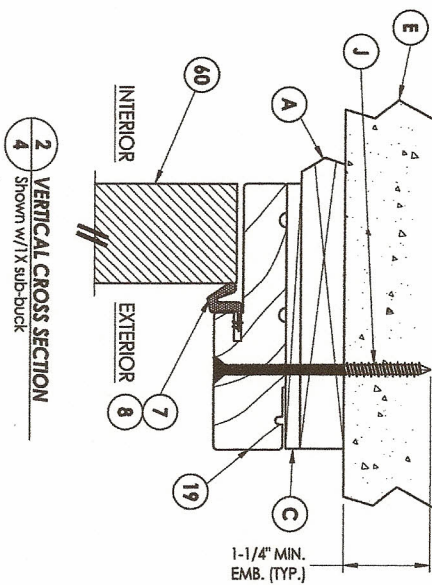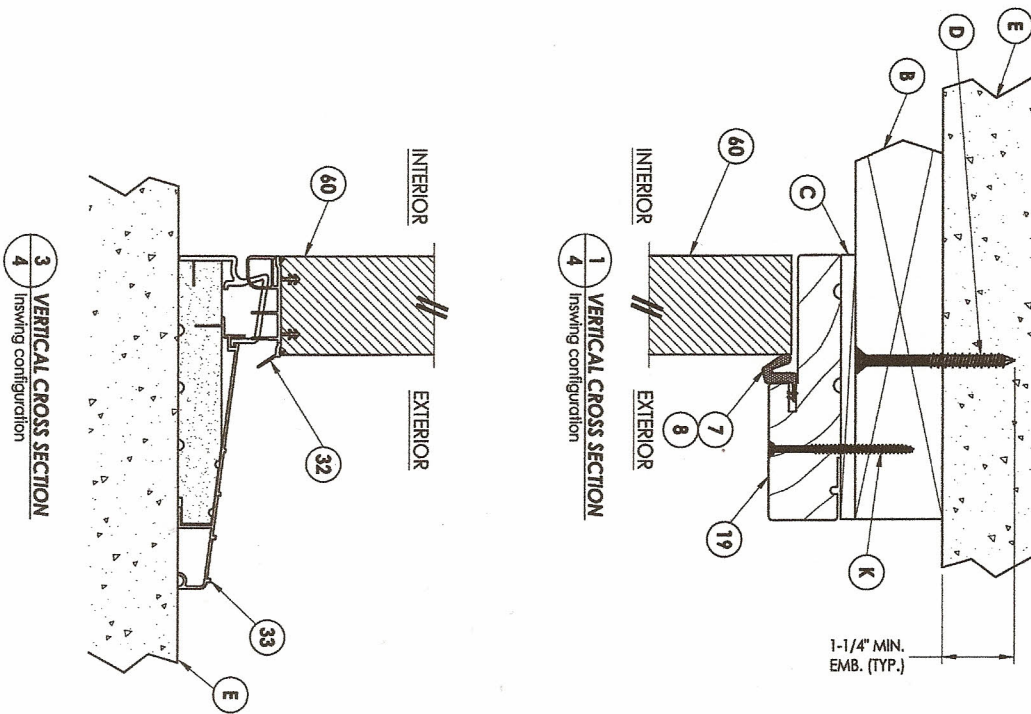


SHEET 4 OF 7		PRODUCT:		Documents Prepared By: Lyndon F. Schmidt P.E. No. 43409	
DATE 4/23/08		THERMA-TRU FIBERGLASS DOOR		 BUILDING CONSULTANTS, INC. P.O. Box 230, Valrico, FL 33595 Phone No.: 813.659.9197 FBPE C.A. No. 9813	
SCALE: N.T.S.		PART OR ASSEMBLY:			
DWG. BY: AL		VERTICAL CROSS SECTIONS			
CHK. BY: LFS					
DRAWING NO.: FL-5891.3					




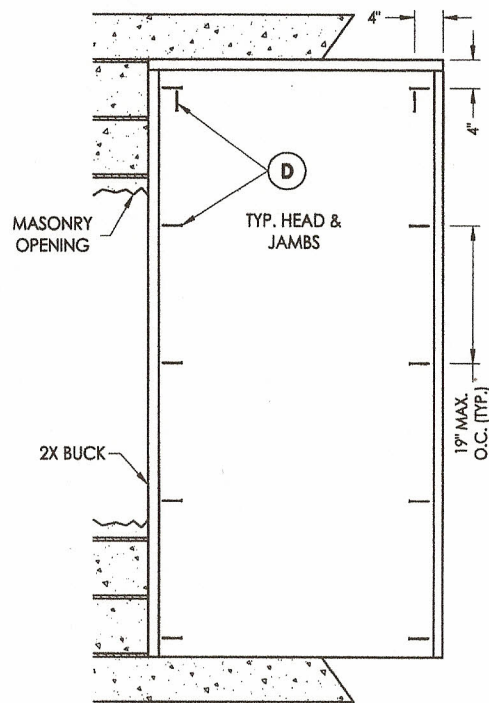


BUCK ANCHORING



STRIKE JAMB

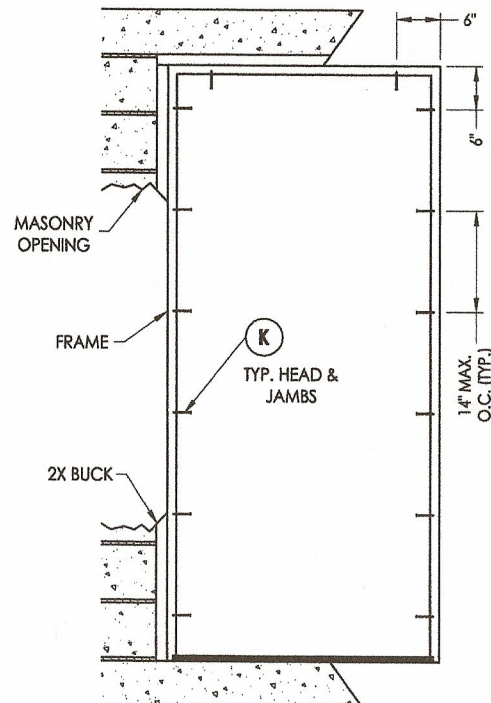

FRAME ANCHORING
Masonry 2X buck construction

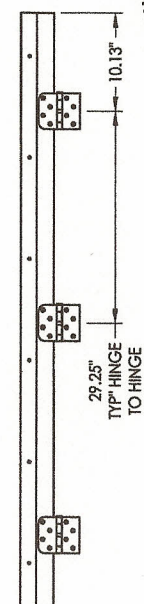

HINGE JAMB


CONCRETE ANCHOR NOTES:

- Concrete anchor locations at the corners may be adjusted to maintain the min. edge distance to mortar joints.
- Concrete anchor locations noted as "MAX. ON CENTER" must be adjusted to maintain the min. edge distance to mortar joints, additional concrete anchors may be required to ensure the "MAX. ON CENTER" dimension are not exceeded.
- Concrete anchor table:


ANCHOR TYPE	ANCHOR SIZE	MIN. EMBEDMENT	MIN. CLEARANCE TO MASONRY EDGE	MIN. CLEARANCE TO ADJACENT ANCHOR
ITW TAPCON®	1/4"	1-1/4"	2"	4"
ELCO ULTRACON®	1/4"	1-1/4"	1"	4"

WOOD SCREW INSTALLATION NOTES:

- Maintain a minimum 5/8" edge distance, 1" end distance, & 1" o.c. spacing of wood screws to prevent the splitting of wood.



HINGE DETAIL



LATCH & DEADBOLT DETAIL

STATE OF FLORIDA
PROFESSIONAL ENGINEER
LYNDON F. SCHMIDT
No. 43409
P.E. No. 43409

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

PRODUCT: THERMA-TRU FIBERGLASS DOOR


PART OR ASSEMBLY: BUCK AND FRAME ANCHORING 2X BUCK MASONRY CONSTRUCTION

DATE: 4/23/08
SCALE: N.T.S.
DWG. BY: AL
CHK. BY: LFS
DRAWING NO.: FL-5891.3
SHEET 5 **OF** 7


REVISIONS

2 1/28/15 UPDATE TO 5TH ED. (2014) FBC
1 6/11/12 REVISED TO 2010 FBC
NOI DATE


© 2008 R.W. BUILDING CONSULTANTS INC.




STRIKE JAMB

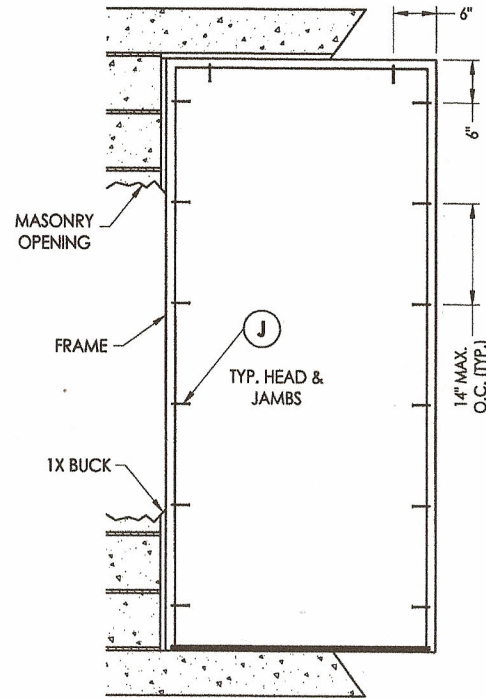


FRAME ANCHORING
Masonry 1X buck construction

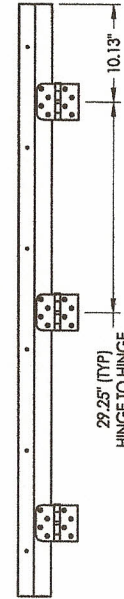

HINGE JAMB



LATCH & DEADBOLT DETAIL



HINGE DETAIL

CONCRETE ANCHOR NOTES:

1. Concrete anchor locations at the corners may be adjusted to maintain the min. edge distance to mortar joints.
2. Concrete anchor locations noted as "MAX. ON CENTER" must be adjusted to maintain the min. edge distance to mortar joints, additional concrete anchors may be required to ensure the "MAX. ON CENTER" dimension are not exceeded.
3. Concrete anchor table:

ANCHOR TYPE	ANCHOR SIZE	MIN. EMBEDMENT	MIN. CLEARANCE TO MASONRY EDGE	MIN. CLEARANCE TO ADJACENT ANCHOR
ITW TAPCON®	1/4"	1-1/4"	2"	4"
ITW TAPCON®	3/16"	1-1/4"	3"	1-1/2"

WOOD SCREW INSTALLATION NOTES:

1. Maintain a minimum 5/8" edge distance, 1" end distance, & 1" o.c. spacing of wood screws to prevent the splitting of wood.

Professional Engineer
E. SCHMIDT
No. 43409
STATE OF FLORIDA
P.E. No. 43409

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

Therma-Tru
FIBERGLASS DOOR

Part or Assembly:
FRAME ANCHORING 1X BUCK
MASONRY CONSTRUCTION


REVISIONS

NO.	DATE	BY	REVISIONS
2	1/28/15	LFS	UPDATE TO 5TH ED. (2014) FBC
1	6/11/12	JK	REVISED TO 2010 FBC


DATE: 4/23/08
SCALE: N.T.S.
DWG. BY: AL
CHK. BY: LFS
DRAWING NO.: FL-5891.3
SHEET 6 OF 7

© 2008 R.W. BUILDING CONSULTANTS INC.


BILL OF MATERIALS		
ITEM	DESCRIPTION	MATERIAL
A	1X BUCK SG ≥ 0.55	WOOD
B	2X BUCK SG ≥ 0.55	WOOD
C	MAX. 1/4" SHIM SPACE	WOOD
D	1/4" X 2-3/4" PFH ELCO OR ITW CONCRETE SCREW	STEEL
E	MASONRY - 3,000 PSI MIN. CONCRETE CONFORMING TO ACI 301 OR HOLLOW BLOCK CONFORMING TO ASTM C90	CONCRETE
G	3/16" X 3-1/4" PFH ITW CONCRETE SCREW	STEEL
H	1/4" X 3-1/4" PFH ITW CONCRETE SCREW	STEEL
J	1/4" X 3-3/4" PFH ITW CONCRETE SCREW	STEEL
K	#8 X 2-1/2" PFH WOOD SCREW	STEEL
L	#10 X 2" PFH WOOD SCREW	STEEL
7	SHORT REACH COMPRESSION WEATHERSTRIP	FOAM
8	LONG REACH COMPRESSION WEATHERSTRIP	FOAM
9	4" X 4" HINGE .097" THK.	STEEL
10	#10 X 3/4" PFH WOOD SCREW	STEEL
17	KWIKSET SIGNATURE SERIES PASSAGE LOCK	STEEL
18	LOW PROFILE OUTSWING BUMP FACE THRESHOLD	ALUM./WOOD
19	HEADER JAMB (PINE, S.G. ≥ 0.42)	WOOD
20	SIDE JAMB (PINE, S.G. ≥ 0.42)	WOOD
21	KWIKSET SIGNATURE SERIES (780) DEADBOLT	STEEL
27	LATCH STRIKE PLATE	STEEL
28	DEADBOLT PLATE	STEEL
32	DOOR BOTTOM SWEEP	PVC
33	SELF ADJUSTING INSWING SADDLE THRESHOLD	ALUM.COMP.
60	FIBERGLASS DOOR PANEL - CLASSIC CRAFT	-
61	CC DOOR SKIN .098" MIN. THK. FIBERGLASS BY THERMA-TRU WITH YIELD STRENGTH F_y (MIN.) = 6,000 PSI	SMC
62	TOP RAIL	COMPOSITE
63	LATCH STILE	LVL WOOD
64	HINGE STILE	WOOD
65	BOTTOM RAIL	COMPOSITE
66	POLYURETHANE FOAM CORE - 1.9 LBS. DENSITY	FOAM

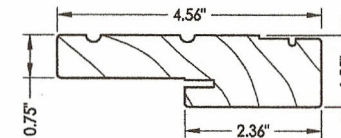NOTE: WOOD/LVL COMPONENTS (OAK CAP, PINE CORE; SG ≥ 0.42)

19 20 HEAD & SIDE Jamb

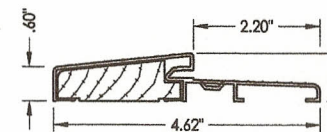

18 LOW PROFILE OUTSWING BUMP FACE

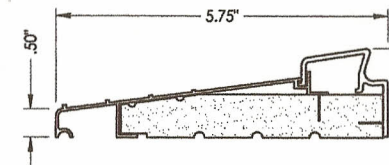

33 SELF ADJUSTING SADDLE THRESHOLD

		Documents Prepared By: Lyndon F. Schmidt P.E. No. 43408		BUILDING CONSULTANTS, INC. P.O. Box 230, Valrico, FL 33595 Phone No.: 813.659.9187 FBPE C.A. No. 9813									
		PRODUCT: THERMA-TRU FIBERGLASS DOOR PART OR ASSEMBLY: BILL OF MATERIAL & COMPONENTS											
DATE: 4/23/08 SCALE: N.T.S. DWG. BY: AL CHK. BY: LFS DRAWING NO.: FL-5891.3 SHEET 7 OF 7		REVISIONS <table border="1"> <thead> <tr> <th>NO.</th> <th>DATE</th> <th>DESCRIPTION</th> </tr> </thead> <tbody> <tr> <td>1</td> <td>6/11/12</td> <td>REVISED TO 2010 FBC</td> </tr> <tr> <td>2</td> <td>1/28/15</td> <td>UPDATE TO 5TH ED. (2014) FBC</td> </tr> </tbody> </table>		NO.	DATE	DESCRIPTION	1	6/11/12	REVISED TO 2010 FBC	2	1/28/15	UPDATE TO 5TH ED. (2014) FBC	LFS JK BY
NO.	DATE	DESCRIPTION											
1	6/11/12	REVISED TO 2010 FBC											
2	1/28/15	UPDATE TO 5TH ED. (2014) FBC											

THERMA TRU®

THERMA TRU DOORS

118 INDUSTRIAL DR., EDBERTON, OH 43517
TEL. (419)298-1740


3'0" X 8'0" "FIBER CLASSIC" FIBERGLASS SINGLE DOOR INSWING / OUTSWING "IMPACT"

GENERAL NOTES

1. This product has been evaluated and is in compliance with the 2010 Florida Building Code (FBC) structural requirements excluding the "High Velocity Hurricane Zone" (HVHZ).
2. Product anchors shall be as listed and spaced as shown on details. Anchor embedment to base material shall be beyond wall dressing or stucco.
3. When used in areas requiring wind borne debris protection this product complies with Section 1609.1.2 of the FBC and does not require an impact resistant covering. This product meets missile level "D" and excludes Wind Zone 4 as defined in ASTM E1996.
4. For 2x stud framing construction, anchoring of these units shall be the same as that shown for 2x buck masonry construction.
5. Site conditions that deviate from the details of this drawing require further engineering analysis by a licensed engineer or registered architect.

TABLE OF CONTENTS

SHEET #	DESCRIPTION
1	Typical elevations, design pressures & general notes
2	Door panel details
3	Horizontal cross sections
4	Vertical cross sections
5	Buck and frame anchoring - 2X buck masonry construction
6	Frame anchoring - 1X buck masonry construction
7	Bill of Materials & Components

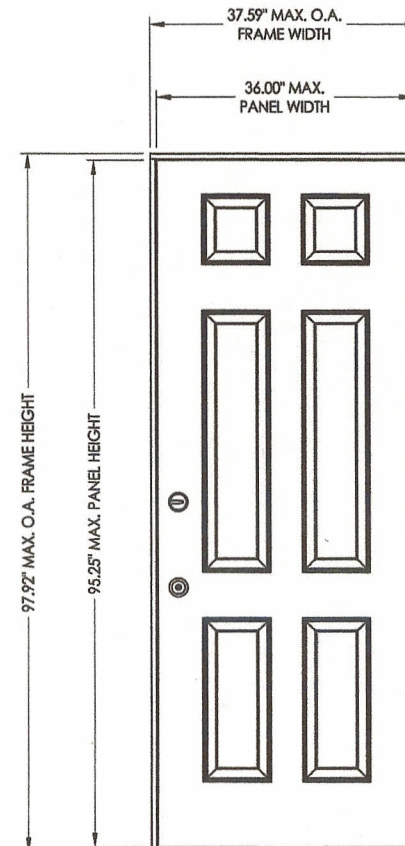


SWING	OVERALL FRAME DIMENSION	DESIGN PRESSURE (PSF)	
		POSITIVE	NEGATIVE
INSWING	37.59" x 97.92"	+67.0	-67.0
OUTSWING	37.59" x 96.42"	+67.0	-67.0

Documents Prepared By:
RW BUILDING CONSULTANTS, INC.
P.O. Box 230 Volrico FL 33595
Phone No.: 813.859.9197
Florida Board of Professional Engineers
Certificate Of Authorization No. 9813
17 SL 6-14-12
Lyndon F. Schmidt, P.E. No. 43409




PRODUCT: THERMA-TRU
FIBERGLASS DOOR
PART OR ASSEMBLY:
TYPICAL ELEVATION, DESIGN
PRESSURES & GENERAL NOTES

NO.	DATE	REVISIONS
1	6/11/12	REVISED TO 2010 FBC
		BY


DATE: 4/23/08
SCALE: N.T.S.
DWG. BY: AL
CHK. BY: LFS
DRAWING NO.:
FL-5891.4
SHEET 1 OF 7

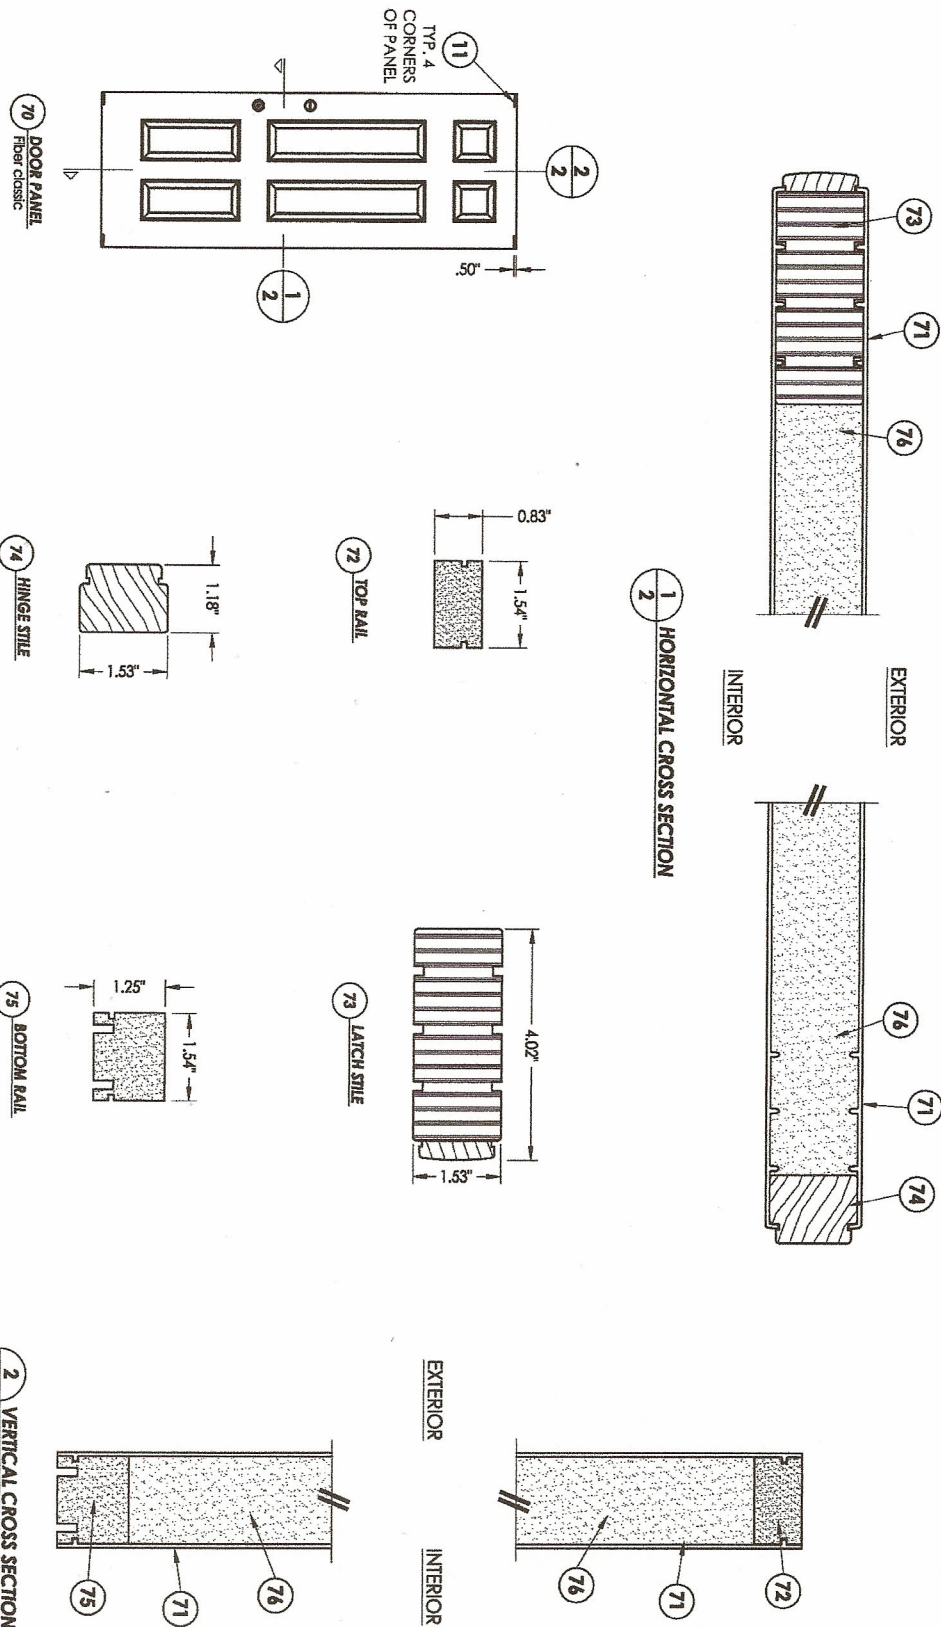


SHEET 2 OF 7		DATE: 4/23/08		SCALE: N.T.S.		DWG. BY: AL		CHK. BY: LFS		DRAWING NO.: FL-5891.4		PRODUCT: THERMA-TRU FIBERGLASS DOOR		PART OR ASSEMBLY: DOOR PANEL DETAILS		Documents Prepared By: R.W. BUILDING CONSULTANTS, INC. P.O. Box 230 Valrico FL 33595 Phone No.: 813.659.9197 Florida Board of Professional Engineers Certificate Of Authorization No. 9613 6752 6.14.12 Lyndon F. Schmidt, P.E. No. 43409	
NO.		DATE		REVISED TO 2010 FBC		BY		JK		REVISIONS							
1		6/11/12															

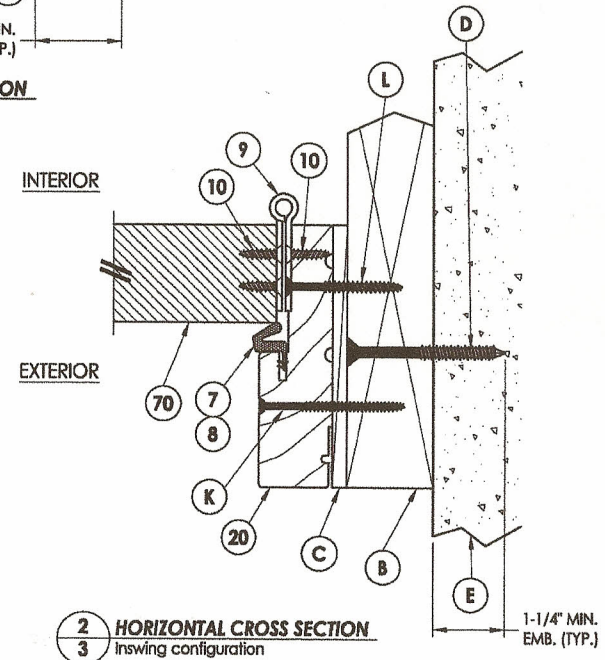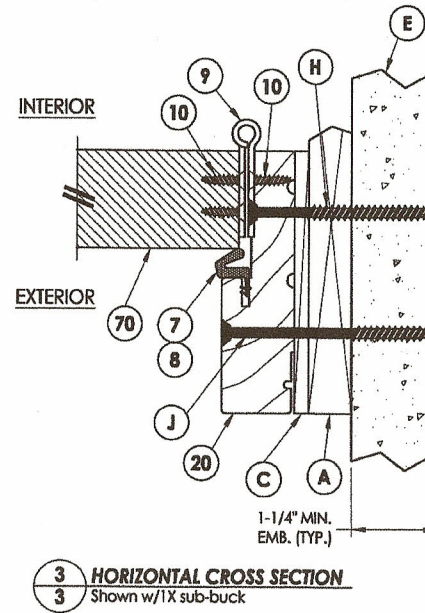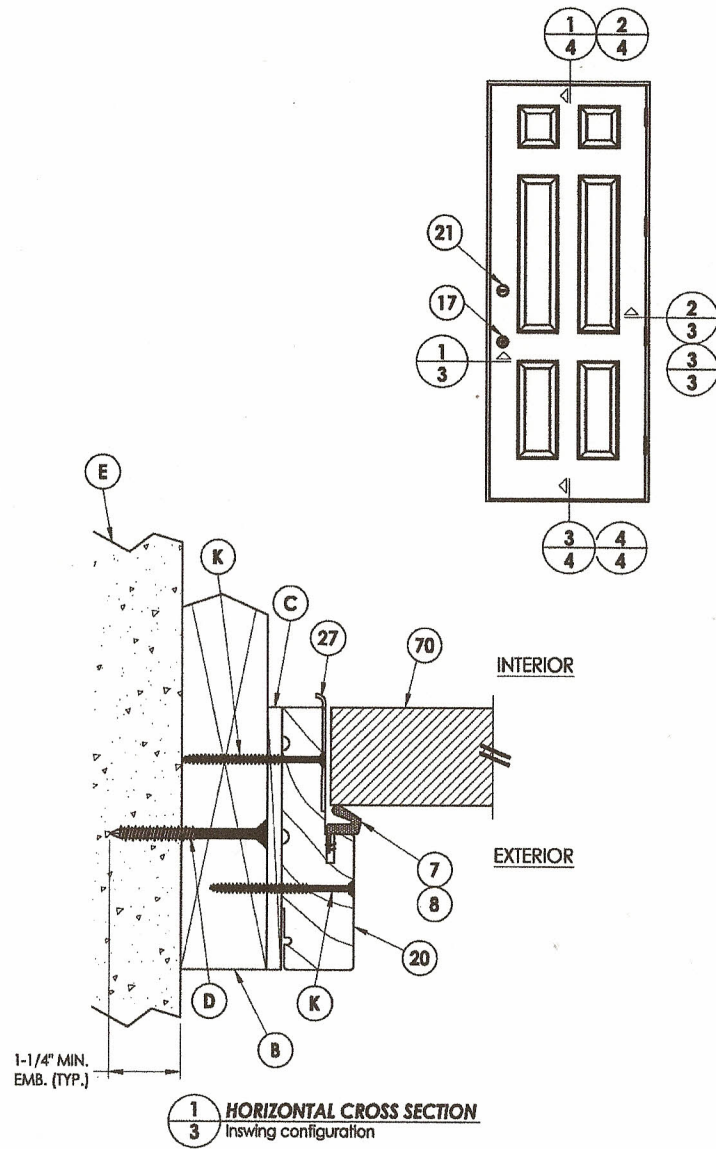


Documents Prepared By:		BUILDING CONSULTANTS, INC.	
		P.O. Box 230 Valrico FL 33595	
		Phone No.: 813.659.9197	
		Florida Board of Professional Engineers	
		Certificate of Authorization No. 8813	
		Lyndon F. Schmidt, P.E. No. 43409	
PRODUCT:		THERMA-TRU FIBERGLASS DOOR	
PART OR ASSEMBLY:		HORIZONTAL CROSS SECTION	
NO.		DATE	
1		6/11/12	
REVISED TO		2010 FBC	
BY		JK	
REVISIONS			
DATE:		4/23/08	
SCALE:		N.T.S.	
DWG. BY:		AL	
CHK. BY:		LFS	
DRAWING NO.:		FL-5891.4	
SHEET		3 OF 7	

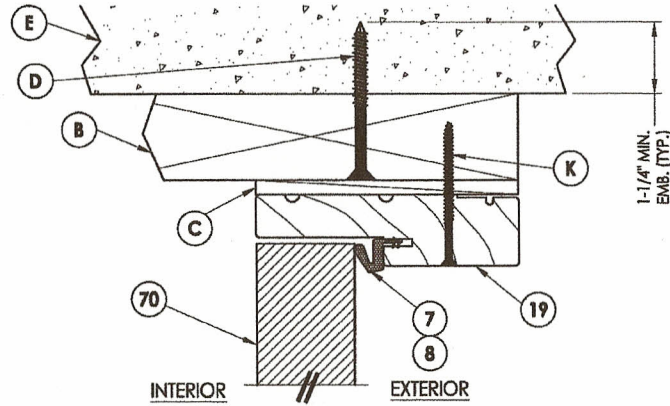


1
4 **VERTICAL CROSS SECTION**
Inswing configuration

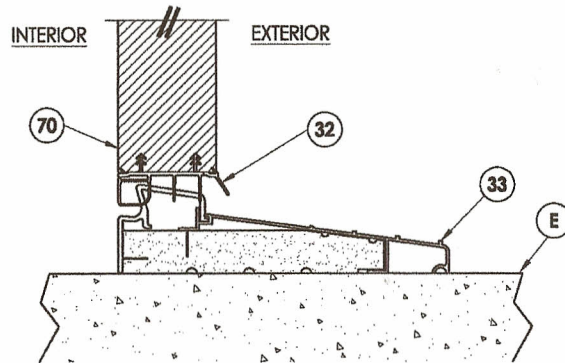

3
4 **VERTICAL CROSS SECTION**
Inswing configuration

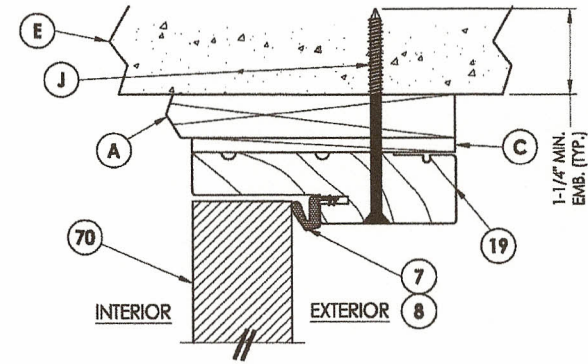


2
4 **VERTICAL CROSS SECTION**
Shown w/1X sub-buck

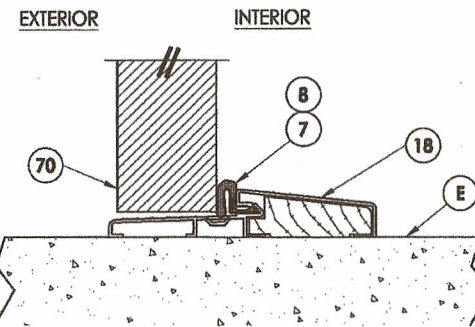


4
4 **VERTICAL CROSS SECTION**
Outswing configuration


Documents Prepared By:		R.W. BUILDING CONSULTANTS, INC. P.O. Box 230 Volusia, FL 32905 Phone No.: 813.659.9197 Florida Board of Professional Engineers Certificate Of Authorization No. 9813 <i>LFS</i> Lyndon F. Schmidt, P.E. No. 43409	
PRODUCT:	THERMA-TRU FIBERGLASS DOOR	PART OR ASSEMBLY:	VERTICAL CROSS SECTIONS
NO.	1	DATE	6/11/12
NO.	2	DATE	6/11/12
NO.	3	DATE	6/11/12
NO.	4	DATE	6/11/12
NO.	5	DATE	6/11/12
NO.	6	DATE	6/11/12
NO.	7	DATE	6/11/12
NO.	8	DATE	6/11/12
NO.	9	DATE	6/11/12
NO.	10	DATE	6/11/12
NO.	11	DATE	6/11/12
NO.	12	DATE	6/11/12
NO.	13	DATE	6/11/12
NO.	14	DATE	6/11/12
NO.	15	DATE	6/11/12
NO.	16	DATE	6/11/12
NO.	17	DATE	6/11/12
NO.	18	DATE	6/11/12
NO.	19	DATE	6/11/12
NO.	20	DATE	6/11/12
NO.	21	DATE	6/11/12
NO.	22	DATE	6/11/12
NO.	23	DATE	6/11/12
NO.	24	DATE	6/11/12
NO.	25	DATE	6/11/12
NO.	26	DATE	6/11/12
NO.	27	DATE	6/11/12
NO.	28	DATE	6/11/12
NO.	29	DATE	6/11/12
NO.	30	DATE	6/11/12
NO.	31	DATE	6/11/12
NO.	32	DATE	6/11/12
NO.	33	DATE	6/11/12
NO.	34	DATE	6/11/12
NO.	35	DATE	6/11/12
NO.	36	DATE	6/11/12
NO.	37	DATE	6/11/12
NO.	38	DATE	6/11/12
NO.	39	DATE	6/11/12
NO.	40	DATE	6/11/12
NO.	41	DATE	6/11/12
NO.	42	DATE	6/11/12
NO.	43	DATE	6/11/12
NO.	44	DATE	6/11/12
NO.	45	DATE	6/11/12
NO.	46	DATE	6/11/12
NO.	47	DATE	6/11/12
NO.	48	DATE	6/11/12
NO.	49	DATE	6/11/12
NO.	50	DATE	6/11/12
NO.	51	DATE	6/11/12
NO.	52	DATE	6/11/12
NO.	53	DATE	6/11/12
NO.	54	DATE	6/11/12
NO.	55	DATE	6/11/12
NO.	56	DATE	6/11/12
NO.	57	DATE	6/11/12
NO.	58	DATE	6/11/12
NO.	59	DATE	6/11/12
NO.	60	DATE	6/11/12
NO.	61	DATE	6/11/12
NO.	62	DATE	6/11/12
NO.	63	DATE	6/11/12
NO.	64	DATE	6/11/12
NO.	65	DATE	6/11/12
NO.	66	DATE	6/11/12
NO.	67	DATE	6/11/12
NO.	68	DATE	6/11/12
NO.	69	DATE	6/11/12
NO.	70	DATE	6/11/12
NO.	71	DATE	6/11/12
NO.	72	DATE	6/11/12
NO.	73	DATE	6/11/12
NO.	74	DATE	6/11/12
NO.	75	DATE	6/11/12
NO.	76	DATE	6/11/12
NO.	77	DATE	6/11/12
NO.	78	DATE	6/11/12
NO.	79	DATE	6/11/12
NO.	80	DATE	6/11/12
NO.	81	DATE	6/11/12
NO.	82	DATE	6/11/12
NO.	83	DATE	6/11/12
NO.	84	DATE	6/11/12
NO.	85	DATE	6/11/12
NO.	86	DATE	6/11/12
NO.	87	DATE	6/11/12
NO.	88	DATE	6/11/12
NO.	89	DATE	6/11/12
NO.	90	DATE	6/11/12
NO.	91	DATE	6/11/12
NO.	92	DATE	6/11/12
NO.	93	DATE	6/11/12
NO.	94	DATE	6/11/12
NO.	95	DATE	6/11/12
NO.	96	DATE	6/11/12
NO.	97	DATE	6/11/12
NO.	98	DATE	6/11/12
NO.	99	DATE	6/11/12
NO.	100	DATE	6/11/12
DATE:	4/23/08	SCALE:	N.T.S.
DWG. BY:	AL	CHK. BY:	LFS
DRAWING NO.:	FL-5891.4	SHEET	4 OF 7

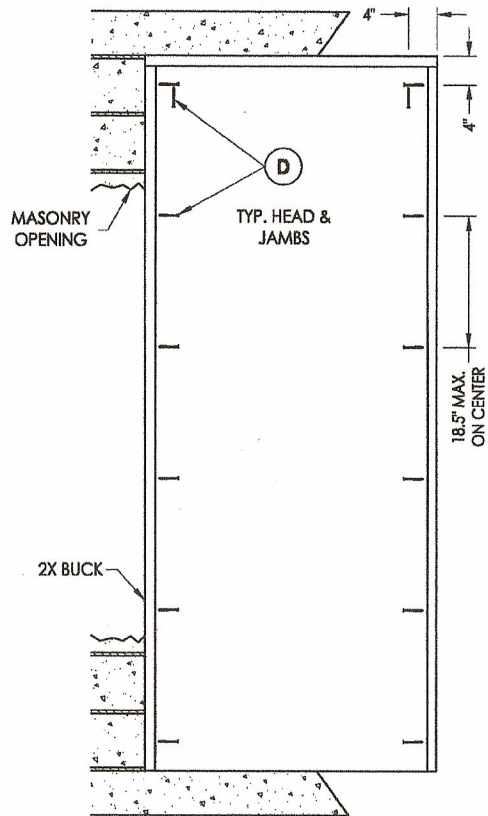


BUCK ANCHORING



STRIKE JAMB

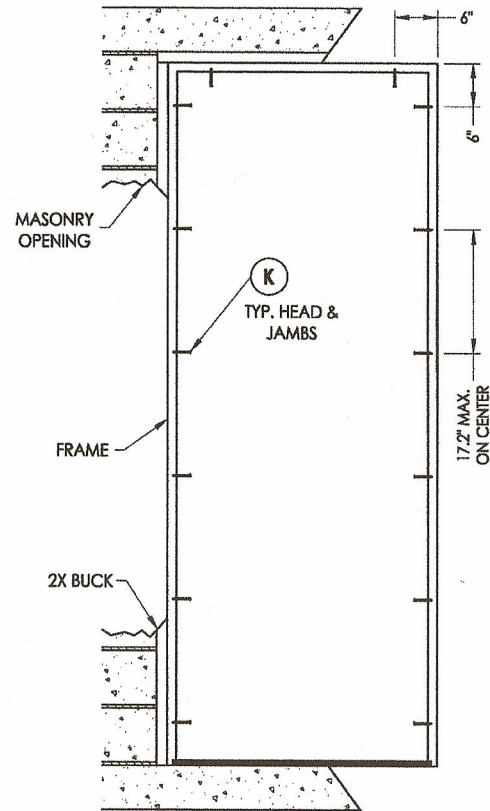

FRAME ANCHORING
Masonry 2X buck construction

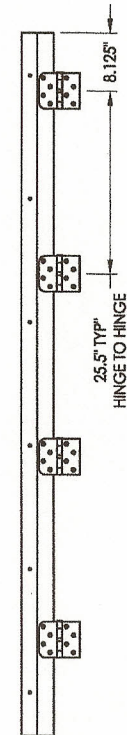


HINGE JAMB


CONCRETE ANCHOR NOTES:

1. Substitution of equal concrete anchors from a different supplier may have different edge distance and center distance requirements.
2. Concrete anchor locations at the corners may be adjusted to maintain the min. edge distance to mortar joints. If concrete anchor locations noted as "MAX. ON CENTER" must be adjusted to maintain the min. edge distance to mortar joints, additional concrete anchors may be required to ensure the "MAX. ON CENTER" dimensions are not exceeded.
3. Concrete anchor table:

ANCHOR TYPE	ANCHOR SIZE	MIN. EMBEDMENT	MIN. CLEARANCE TO MASONRY EDGE	MIN. CLEARANCE TO ADJACENT ANCHOR
ITW	1/4"	1-1/4"	2-1/2"	3"
ELCO	1/4"	1-1/4"	1"	4"



HINGE DETAIL



LATCH & DEADBOLT DETAIL


Documents Prepared By: **RW** BUILDING CONSULTANTS, INC.
P.O. Box 230 Venice FL 33595
Phone No.: 813.699.9197
Florida Board of Professional Engineers
Certificate of Authorization No. 8813
Lynden F. Schmidt, P.E. No. 43409

PRODUCT: THERMA-TRU FIBERGLASS DOOR
PART OR ASSEMBLY: BUCK AND FRAME ANCHORING 2X BUCK MASONRY CONSTRUCTION

NO. DATE BY REVISIONS

1 6/11/12 REVISED TO 2010 FBC JK BY

DATE: 4/23/08
SCALE: N.T.S.
DWG. BY: AL
CHK. BY: LFS
DRAWING NO.: FL-5891.4
SHEET 5 OF 7

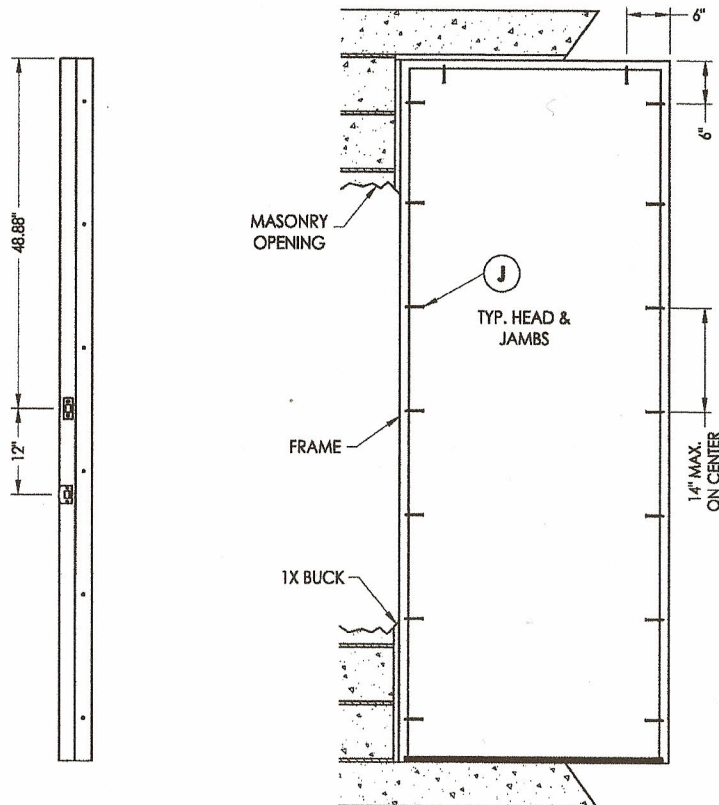


STRIKE JAMB

FRAME ANCHORING
Masonry 1X buck construction


CONCRETE ANCHOR NOTES:

1. Substitution of equal concrete anchors from a different supplier may have different edge distance and center distance requirements.
2. Concrete anchor locations at the corners may be adjusted to maintain the min. edge distance to mortar joints. If concrete anchor locations noted as "MAX. ON CENTER" must be adjusted to maintain the min. edge distance to mortar joints, additional concrete anchors may be required to ensure the "MAX. ON CENTER" dimensions are not exceeded.
3. Concrete anchor table:


ANCHOR TYPE	ANCHOR SIZE	MIN. EMBEDMENT	MIN. CLEARANCE TO MASONRY EDGE	MIN. CLEARANCE TO ADJACENT ANCHOR
ITW	1/4"	1-1/4"	2-1/2"	3"
ITW	3/16"	1-1/4"	2-5/8"	1-1/4"



HINGE JAMB




LATCH & DEADBOLT DETAIL




HINGE DETAIL

Documents Prepared By:		R.W. BUILDING CONSULTANTS, INC. P.O. Box 230 Venice FL 33595 Phone No.: 813.668.8187 Florida Board of Professional Engineers Certificate of Authorization No. 8613 Lyndon F. Schmidt, P.E. No. 43408	
PRODUCT:	Therma-Tru FIBERGLASS DOOR		
PART OR ASSEMBLY:	FRAME ANCHORING 1X BUCK MASONRY CONSTRUCTION		
NO.	DATE	REVISIONS	BY
1	6/11/12	REVISED TO 2010 FBC	JK
DATE: 4/23/08			
SCALE: N.T.S.			
DWG. BY: AL			
CHK. BY: LFS			
DRAWING NO.: FL-5891.4			
SHEET 6 OF 7			


BILL OF MATERIALS		
ITEM	DESCRIPTION	MATERIAL
A	1X BUCK SG ≥ 0.55	WOOD
B	2X BUCK SG ≥ 0.55	WOOD
C	MAX. 1/4" SHIM SPACE	WOOD
D	1/4" X 2-3/4" PFH ELCO OR ITW CONCRETE SCREW	STEEL
E	MASONRY - 3,192 PSI MIN. CONCRETE CONFORMING TO ACI 301 OR HOLLOW BLOCK CONFORMING TO ASTM C90	CONCRETE
G	3/16" X 3-1/4" PFH ITW CONCRETE SCREW	STEEL
H	1/4" x 3-1/4" PFH ITW CONCRETE SCREW	STEEL
J	1/4" X 3-3/4" PFH ITW CONCRETE SCREW	STEEL
K	#8 X 2-1/2" PFH WOOD SCREW	STEEL
L	#10 X 2" PFH WOOD SCREW	STEEL
7	SHORT REACH COMPRESSION WEATHER-STRIP (THERMA-TRU)	FOAM
8	LONG REACH COMPRESSION WEATHER-STRIP (THERMA-TRU)	FOAM
9	4" X 4" HINGE .097" THK. (THERMA-TRU)	STEEL
10	#10 X 3/4" PFH WOOD SCREW (HINGE TO FRAME)	STEEL
11	#9 X 3" PFH WOOD SCREW	STEEL
17	KWIKSET SIGNATURE SERIES PASSAGE LOCK	STEEL
18	LOW PROFILE OUTSWING BUMP FACE THRESHOLD (THERMA-TRU) .050" WALL AL.	ALUM./WOOD
19	HEADER JAMB (4.656" X 1.25" THERMA-TRU, PINE)	WOOD
20	SIDE JAMB (4.656" X 1.25" THERMA-TRU, PINE)	WOOD
21	KWIKSET SIGNATURE SERIES (780) DEADBOLT	STEEL
27	LATCH STRIKE PLATE	STEEL
28	DEADBOLT PLATE	STEEL
32	DOOR BOTTOM SWEEP	PVC
33	SELF ADJUSTING INSWING SADDLE THRESHOLD (.45" WALL AL. - .080" WALL VINYL)	ALUM.COMP.
70	FIBERGLASS DOOR PANEL - FIBER CLASSIC	-
71	FC DOOR SKIN .110" MIN. THK. FIBERGLASS BY THERMA-TRU WITH YIELD STRENGTH F_y (MIN.) = 6,000 PSI	SMC
72	TOP RAIL	COMPOSITE
73	LATCH STILE	LVL WOOD
74	HINGE STILE	WOOD
75	BOTTOM RAIL	COMPOSITE
76	POLYURETHANE FOAM CORE - BASF 1.9 LBS. DENSITY	FOAM

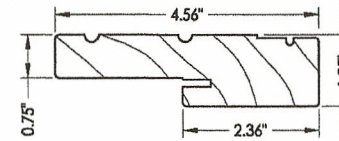

19 20 HEAD & SIDE Jamb

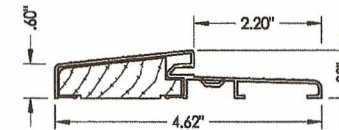

18 LOW PROFILE OUTSWING BUMP FACE

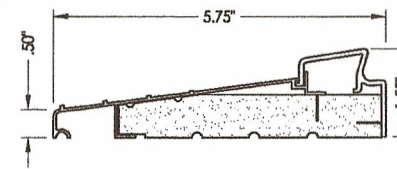

33 SELF ADJUSTING SADDLE THRESHOLD

Documents Prepared By:
R.W. BUILDING CONSULTANTS, INC.
 P.O. Box 230 Vero Beach, FL 33595
 Phone No.: 813.659.9197
 Florida Board of Professional Engineers
 Certificate of Authorization No. 9813
 6-14-12
 Lyndon F. Schmidt, P.E. No. 43409

PRODUCT: THERMA-TRU FIBERGLASS DOOR
 PART OR ASSEMBLY: BILL OF MATERIAL & COMPONENTS

NO.	DATE	REVISIONS
1	6/11/12	REVISED TO 2010 FBC
JK		BY

DATE: 4/23/08
 SCALE: N.T.S.
 DWG. BY: AL
 CHK. BY: LFS
 DRAWING NO.: FL-5891.4
 SHEET 7 OF 7


Store: SCOTT PAINT
Store: 2 VENICE Time: 06:12:27
Can #: 1 of 1 Date: 11/06/2013
Base ID: WHITE
Job ID: 0 Size: 1 GALLON
Color Code/Description:
HAMMOCKS / BLDGS A ENTRY
DOORS / ICI 44YY 70/110 / WHITE
Product Description:

Formula:

C-25
I-2
B-5

Rev. Date: 11/06/2013

CUSTOM COLOR NOT
RETURNABLE

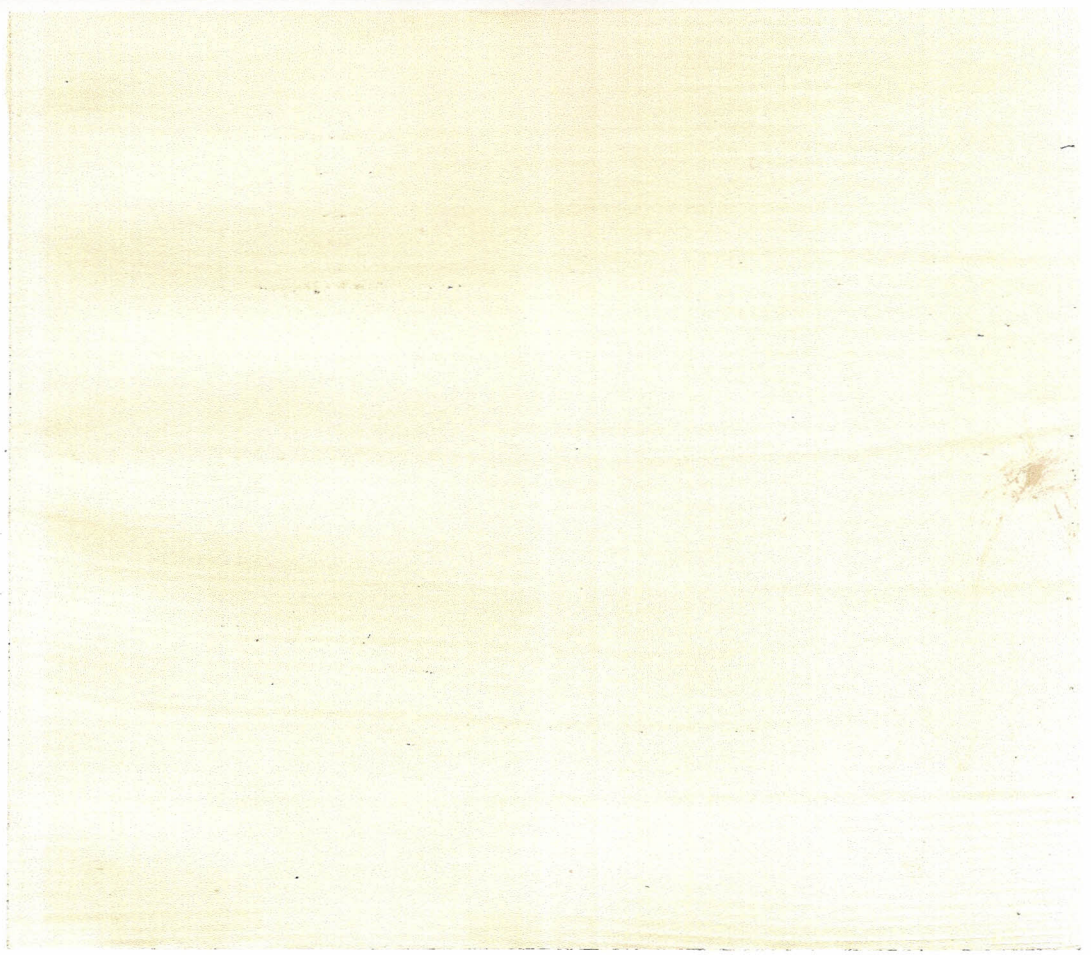

'A' Buildings

10600, 106001, 10620, 10640, 10641, 10641, 10700, 10720

Front Entry Door – THERMA TRU DOOR – 3'0" X 6'8" "CLASSIC CRAFT"

**Rear Entry Door and Garage Entry Door – THERMA TRU DOOR – 3'0"X8'0"
"CLASSIC CRAFT"**

Store: SCOTT PAINT
Store: 2 VENICE Time: 09:56:14
Can # 1 of 1 Date: 04/09/2015
Base ID: ACCENT
Job ID: 0 Size: 1 GALLON
Color Code/Description:
HAMMOCKS / BLDGS B DOORS
ENTRY / ICI 90GG 13/087(2015
Product Description:

Formula:

D-5Y13.13
KX-3Y24
I-1Y17
B-2Y44.63

Rev. Date: 04/09/2015

CUSTOM COLOR NOT
RETURNABLE

Ultrashield Color LLC



'B' Buildings

8500, 8520, 8540, 8560, 8581, 10520, 10540, 10550

Front Entry Door – THERMA TRU DOOR – 3'0" X 8'0" "CLASSIC CRAFT"

Store: SCOTT PAINT
Store: 2 VENICE Time: 13:19:30
Can # 1 of 1 Date: 05/14/2014
Base ID: WHITE
Job ID: 0 Size: 1 GALLON
Color Code/Description:
HAMMOCKS / BLDGS C ENTRY
DOORS / ICI 30GG 50/107 (1405) /
Product Description:

Formula:

D-1Y32
C-9.5
I-30

Rev. Date: 05/14/2014

CUSTOM COLOR NOT
RETURNABLE



'C' Buildings

8541, 8561, 8571, 10501, 10521

Front Entry Door – THERMA TRU DOOR – 3'0" X 8'0" "CLASSIC CRAFT"

Available on Amazon.com



Kwikset Lido Hall/Closet Lever in Satin Nickel

by Kwikset



Kwikset 660 Single Cylinder Deadbolt in Satin Nickel

by Kwikset



Cart: 0 items

Door Knocker Viewer, 4 In. With 1/2 In. Bore 160 Degree Viewer



Start Your Purchase

Price:

\$5.17

QTY:

1

You'll be able to edit items in your cart at checkout.

In Stock: 3,609